


\$USER\$
 \$STYLES
 \$DATE\$

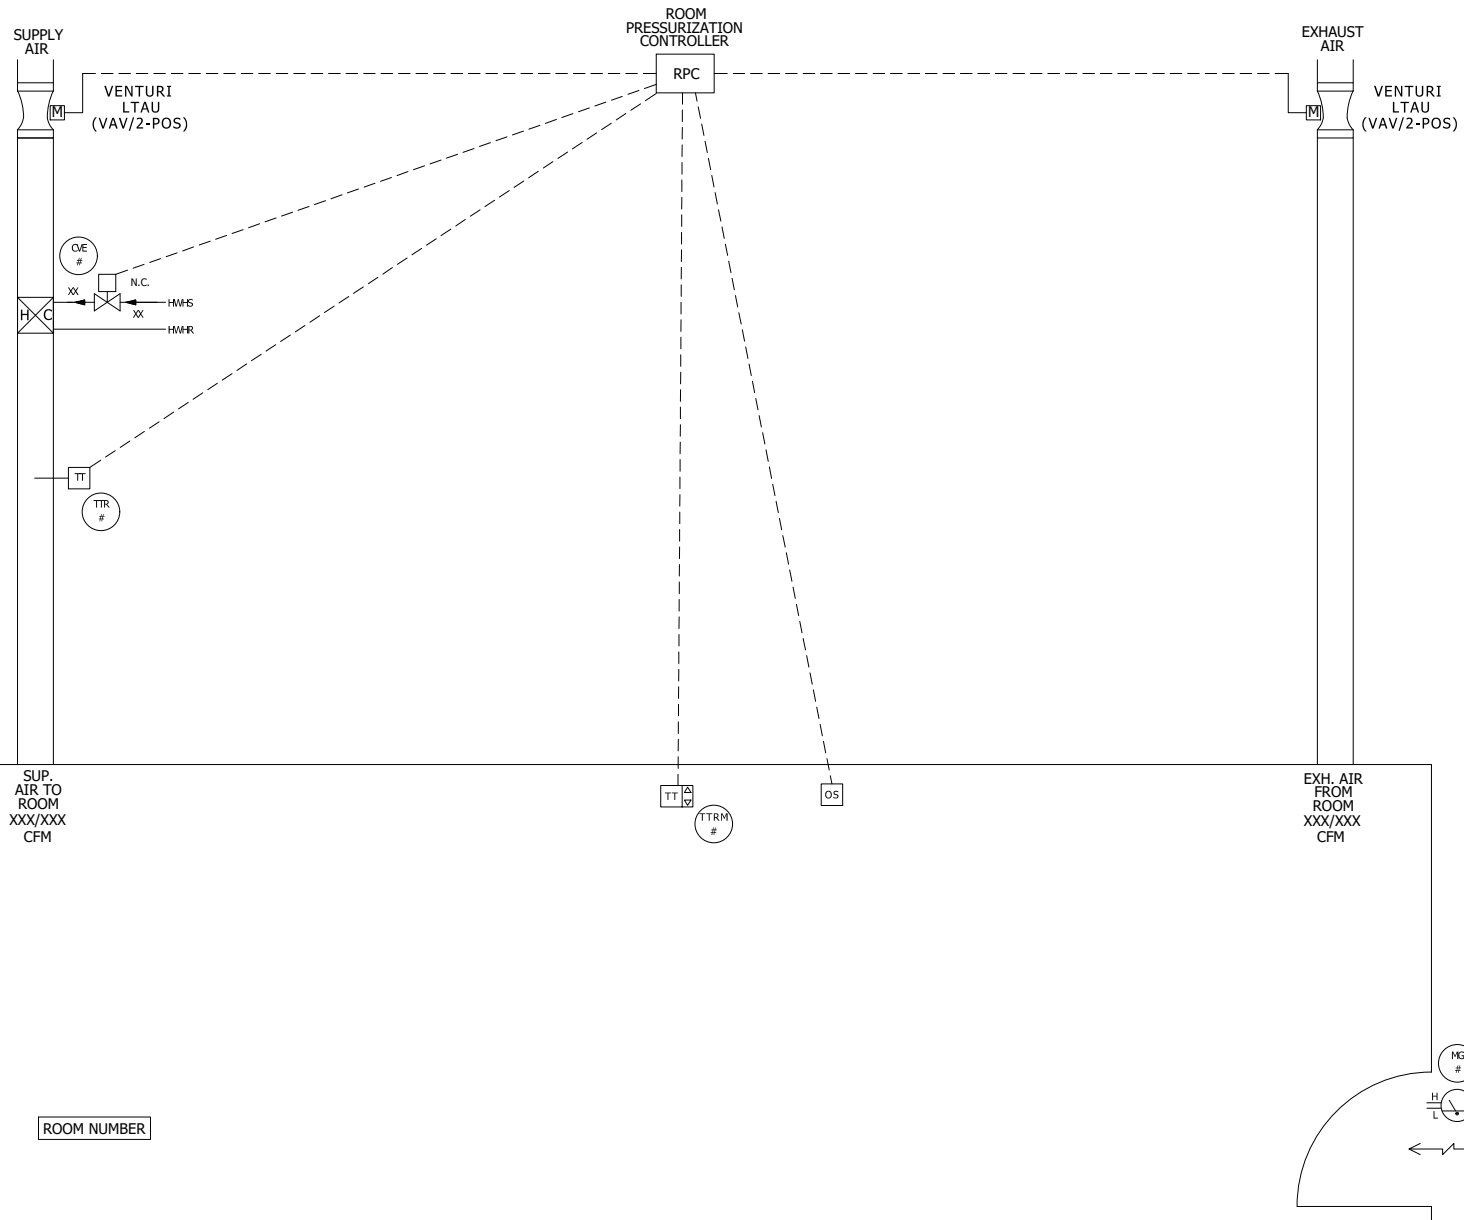

VIVARIUM NON-HOLDING ROOM CONTROL

SEQUENCE OF OPERATION

VAV CONTROL

THE OCCUPANCY SENSOR INDEXES THE ROOM BETWEEN OCCUPIED AND UNOCCUPIED MODES OF OPERATION. THE THERMOSTAT OVERRIDE BUTTON CAUSES THE SYSTEM TO REVERT TO THE OCCUPIED MODE OF OPERATION FOR A PERIOD OF 2 HOURS.

OCCUPIED MODE - THE BAS MODULATES THE REHEAT COIL VALVE AND SUPPLY AIR FLOW BETWEEN ITS MINIMUM AND MAXIMUM SETTINGS IN SEQUENCE TO MAINTAIN THE SPACE TEMP AT SETPOINT. THE EXHAUST AIR FLOW TRACKS THE SUPPLY AIR FLOW TO MAINTAIN ROOM PRESSURE.

UNOCCUPIED MODE - THE BAS MODULATES THE REHEAT COIL VALVE TO MAINTAIN THE SPACE TEMP AT SETPOINT AND SETS THE SUPPLY AIR FLOW TO ITS MINIMUM SETTING. THE EXHAUST AIR FLOW TRACKS THE SUPPLY AIR FLOW TO MAINTAIN ROOM PRESSURE.

2-POSITION CONTROL

THE OCCUPANCY SENSOR INDEXES THE ROOM BETWEEN OCCUPIED AND UNOCCUPIED MODES OF OPERATION. THE THERMOSTAT OVERRIDE BUTTON CAUSES THE SYSTEM TO REVERT TO THE OCCUPIED MODE OF OPERATION FOR A PERIOD OF 2 HOURS.

OCCUPIED MODE - THE BAS MODULATES THE REHEAT COIL VALVE TO MAINTAIN THE SPACE TEMP AT SETPOINT AND SETS THE SUPPLY AIR FLOW TO ITS MAXIMUM SETTING. THE EXHAUST AIR FLOW TRACKS THE SUPPLY AIR FLOW TO MAINTAIN ROOM PRESSURE.

UNOCCUPIED MODE - THE BAS MODULATES THE REHEAT COIL VALVE TO MAINTAIN THE SPACE TEMP AT SETPOINT AND SETS THE SUPPLY AIR FLOW TO ITS MINIMUM SETTING. THE EXHAUST AIR FLOW TRACKS THE SUPPLY AIR FLOW TO MAINTAIN ROOM PRESSURE.

LIGHTING IS CONTROLLED VIA LOCAL TOGGLE SWITCHES (NOT SHOWN). BAS DOES NOT HAVE CONTROL OF LIGHTING

MAGNETIC GAUGE (MG-1) LOCATED OUTSIDE THE ROOM AND ABOUT THE DOOR INDICATES ROOM PRESSURIZATION.

ROOM NO.	TEMP. SETPOINT	HUMIDITY SETPOINT	ROOM PRES.	CFM OFFSET
XXXX	72°F	40% R.H.	NEG.	150

UNIVERSITY OF MICHIGAN
 ARCHITECTURE, ENGINEERING AND CONSTRUCTION
ARCHITECTURE & ENGINEERING
 326 East Hoover, Mail Stop B
 Ann Arbor, MI 48109-1002
 Phone: 734-764-3414
 Fax: 734-936-3334

XXXXXX-XXXX

WORK REQUEST NO.

Abbreviated Documents

ALL WORK SHALL CONFORM WITH APPLICABLE U OF M
 MASTER SPECIFICATIONS (www.umiac.umich.edu).
 U OF M MASTER SPECIFICATIONS FORM A PART OF THESE
 PROJECT DOCUMENTS BY REFERENCE.

TERMS & CONDITIONS FOR DOCUMENT USE

PROPERTY OF THE UNIVERSITY OF MICHIGAN
 SUBJECT TO RESTRICTIONS
 THESE PLANS ARE THE CONFIDENTIAL PROPERTY OF THE
 UNIVERSITY OF MICHIGAN. THESE PLANS HAVE BEEN PROVIDED
 TO YOU FOR THE LIMITED PURPOSE OF BIDDING AND/OR
 PROVIDING CONSTRUCTION WORK AT THE UNIVERSITY OF
 MICHIGAN. YOU ACKNOWLEDGE THAT THESE PLANS ARE THE
 CONFIDENTIAL PROPERTY OF THE UNIVERSITY OF MICHIGAN.
 YOU WILL KEEP THE PLANS CONFIDENTIAL AND WILL NOT
 DISCUSS WITH OR PROVIDE THESE PLANS TO ANY THIRD
 PARTY, OTHER THAN THOSE EMPLOYEES, SUBCONTRACTORS OR
 CONSULTANTS WHO ARE ESSENTIAL TO COMPLETING YOUR BID
 AND/OR WORK, UNLESS YOUR COMPANY IS SELECTED TO
 PERFORM A PART OF THE WORK. YOU WILL DESTROY ALL
 COPIES OF THE PLANS WITHIN 90 DAYS OF THE BID DUE DATE.

U OF M DESIGN SUPERVISOR	_____
APPROVED BY	_____
REPRESENTING	_____
DRAWN BY _____	DESIGN MANAGER _____
DESIGNED BY _____	REVIEWED BY _____

MARK	ISSUED FOR/REVISIONS	DATE

02-11-21

Campus
 University Of Michigan
 Ann_Arbor_, MI

UNIVERSITY OF MICHIGAN
 ARCHITECTURE, ENGINEERING AND CONSTRUCTION
 326 East Hoover, Mail Stop E
 Ann Arbor, MI 48109-1002
 Phone: 734-764-3414
 Fax: 734-936-3334

P000XXXXX **100XXXXX**
 U OF M PROJECT NO. BLDG NO.

SHEET TITLE

Vivarium Non-Holding Control Drawing

SHEET NO. _____

SHEET NO. _____ OF _____

FOR REVIEW ONLY - NOT FOR CONSTRUCTION